



<u>SM1(Mod) - SEMI-MOUNTABLE (MODIFIED) KERB</u>

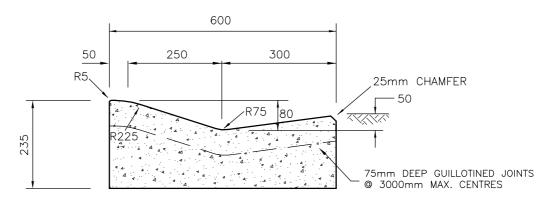

SM2(Mod) - SEMI-MOUNTABLE (MODIFIED) KERB & CHANNEL

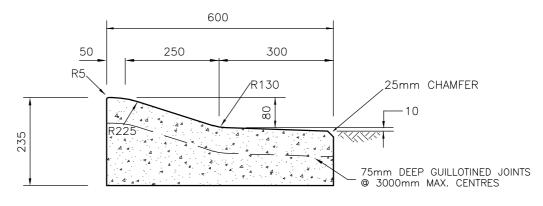

SM3(Mod) - SEMI-MOUNTABLE (MODIFIED) KERB & OUTFALL TRAY

NOTES

- When placed by hand, all concrete shall be compacted with the aid of immersion vibrators or other vibrating equipment as approved by the superintendent.

 2. Concrete shall be 25 MPa minimum.

City of Whittlesea	
SEMI-MOUNTABLE (MODIFIED) KERB & CHANNEL	SD 302
APPROVED Seill Hooling DATE 01/03/06	REV B